


C/D/C

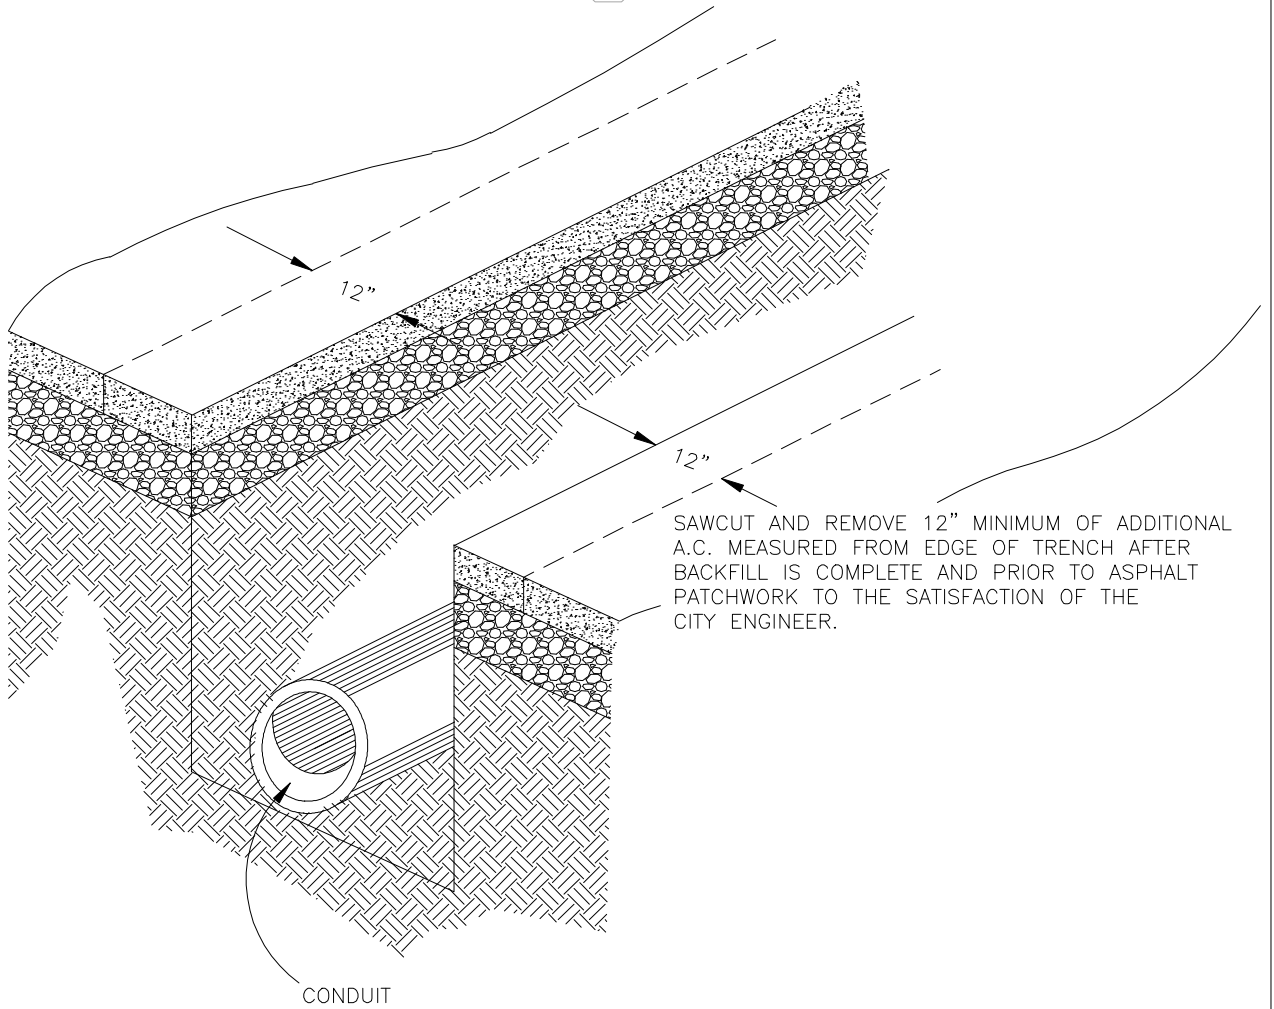

NOTES:

1. BACKFILL SHALL BE PLACED AS SPECIFIED IN SUBSECTIONS 306-1.3.1, 306-1.3.2, AND 306-1.3.4 OF THE STANDARD SPECIFICATIONS FOR PUBLIC WORKS CONSTRUCTION, LATEST EDITION.
2. ASPHALT PATCH SHALL BE PER CITY STANDARDS AND SHALL BE A MINIMUM OF ONE (1") INCH THICKER THAN EXISTING PAVEMENT.
3. ON ARTERIAL STREETS WHERE OPEN TRENCH IS ALLOWED, A MINIMUM OF 8' WIDE SHALL BE GRINDED TO 1 1/2" THICK, COLD PLANED AND REPLACED WITH THE SAME MATERIAL USING MACHINE, THEN TO BE SLURRIED AFTER 30 DAYS AND RESTIPE AS NECESSARY.

PICO WATER DISTRICT

REPAIR OF OPEN TRENCH DETAIL

APP. _____

M. J. Grajeda

**MARK J. GRAJEDA
GENERAL MANAGER**

STANDARD
DRAWING NUMBER

S-25

DATE: SEPT 2008 SHEET 1 OF 2